



EAC Series

Extruded Aluminum
Combination Unit

FEATURES

- Solid extruded aluminum construction, painted factory white
- Universal mounting: end, wall or ceiling
- Meets or exceeds CSA 22.2 No.141-10 standard for unit equipment and pictogram safety signs
- Legend illuminated by long-life white LED's
- Comes standard with two pictogram films per face, for direction selection
- 5W LED emergency lights provide 70' of egress illumination on a 6-foot wide path
- Sealed, maintenance-free Lead-Calcium battery
- Remote load capacity: 70' up to 350' of egress illumination when using LED remote heads
- Advanced diagnostics capabilities (specific load requirements)



nexus®

TYPICAL SPECIFICATIONS

Supply and install the **Emergi-Lite® EAC Series** combination emergency light battery unit and the pictogram Exit Sign. The unit shall be suitable for universal mounting: wall, end, or ceiling. The unit shall include a power pack made of steel and a legend housing including a one-piece extruded aluminum frame. The legend housing shall have a maximum depth of 2-1/2". The face plate(s) shall be of extruded aluminum and shall incorporate a protective clear polycarbonate panel. Each face plate shall come standard with two legend films for pictogram and direction selection. The light source shall be white light-emitting diodes (LED) and shall provide even illumination in normal and emergency operation. The power pack shall be complete unit equipment with battery charger and rechargeable battery. The battery shall be maintenance-free, sealed Lead-Calcium. In case of AC power failure the equipment shall provide minimum 30 minutes of emergency lighting. The rated DC power available for emergency lights shall be 27W or up to 80W, as specified. The emergency heads shall require no tools to adjust and aim. The heads shall be made of durable thermoplastic construction as otherwise specified.

Units with "auto-diagnostic option" shall include a micro-controller circuit to monitor all the critical functions of the equipment and execute periodical tests of one minute every 30 days, 10 minutes every 6 months and 30 minutes every 12 months. In case of equipment malfunction, an LED-based diagnostic display shall generate a service alarm and indicate the cause of failure: battery, charger circuit, emergency lamps or exit sign lamps.

The equipment shall meet or exceed the requirements of CSA 22.2 No.141-10 standard.

The equipment shall be **Emergi-Lite®** Model: _____.

WIRE GUARDS

460.0081-E	Wall mount
460.0060-E	Ceiling mount


EAC Series

Extruded Aluminum
Combination Unit



DIMENSIONS

Dimensions are approximate and subject to change.

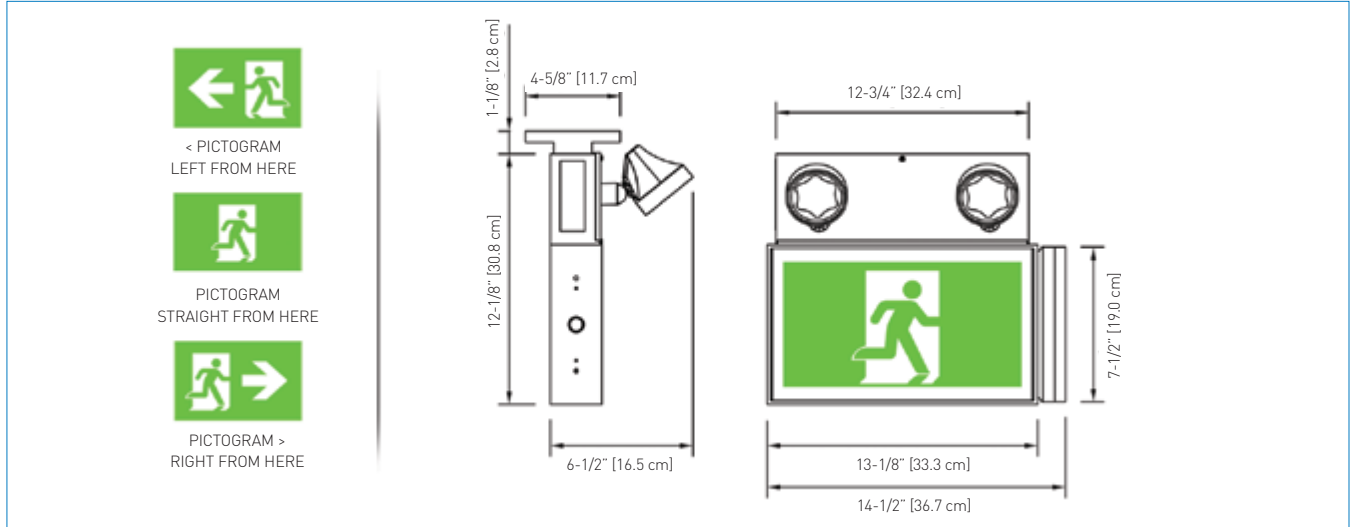

POWER CONSUMPTION

MODEL	AC SPECS		EMERGENCY POWER AVAILABLE FOR LAMPS				
			30MIN	1H00	1H30	2H00	4H00
Pictogram Module	120/347VAC	Less than 1.5W	-	-	-	-	-
EAC-627	120/347VAC	0.15/0.05 A	27	16	11	9	-
EAC-640			40	23	16	13	-
EAC-672			72	42	30	24	12
EAC-1250	120/347VAC	0.25/0.09 A	50	29	21	16	8
EAC-1280			80	46	32	27	13

ORDERING INFORMATION

SERIES	FACES / MOUNTING	COLOUR	POWER EM. LIGHTS	HEADS	LAMP STYLE AND WATTAGE	VOLTAGE	OPTIONS
EAC= pictogram aluminum combination unit	1= single face, universal mounting 2= double face, universal mounting	B= black W= factory white	627= 6V-27W 640= 6V-40W 672= 6V-72W 1250= 12V-50W 1280= 12V-80W	Blank= no heads 1= one head 2= two heads	Blank= no heads LA= MR16 LED, 6V-4W LB= MR16 LED, 6V-5W LG= MR16 LED, 12V-4W LI= MR16 LED, 12V-5W LJ= MR16 LED, 12V-6W	Blank= 120/347 Vac -2= 120/277 input	U= auto-diagnostics ¹ UN= auto-diagnostics, non-audible ¹ NEX= NEXUS [®] system interface ¹ NEXRF= wireless NEXUS [®] system interface ¹ D3= time delay (15 minutes) ² -TP= tamper-proof screws ³ U9= arrow up D9= arrow down U4= arrow up 45° D4= arrow down 45° ¹ Not available with 6V-72W. Not all options available with NEXUS [®] system interface. Please consult your sales representative. ² Available with auto-diagnostics or NEXUS [®] only ³ 990.0119-E= tamper-proof bit (sold separately)

EXAMPLE: EAC1W6272LAD3